



MODEL NO.	L	W	Ds	Hs	Db	Hb
C42-0090-20	38	18	14	77	18	40
C42-0120-20	46	24	16	77	24	41
C42-0150-20	48	24	18	80	24	50
C42-0180-20	51	24	21	74	24	50
C42-0210-20	51	24	21	74	24	50
C42-0240-20	54	24	24	81	24	50
C42-0270-20	54	24	24	87	24	50
C42-0300-20	54	30	24	87	30	50
C42-0450-20	66	30	30	98	30	50
C42-0600-20	81	39	36	95	39	48

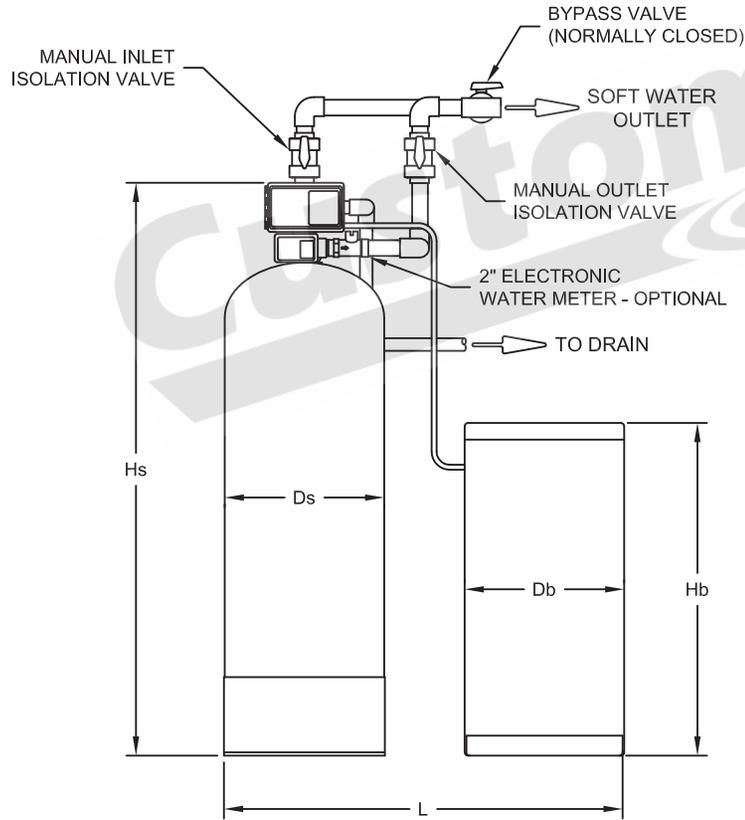


- NOTES:
- 1) VALVE INLET AND OUTLET CONNECTIONS ARE 2" NPTF.
 - 2) VALVE DRAIN CONNECTION IS 1" NPTM.
 - 3) PIPE AND FITTINGS ARE NOT FURNISHED.
 - 4) IT IS RECOMMENDED THAT FLEXIBLE CONNECTORS BE INSTALLED BETWEEN HARD PIPING AND VALVE INLET AND OUTLET CONNECTIONS.
 - 5) THE TANK MANUFACTURER RESERVES THE RIGHT TO INVALIDATE THE TANK WARRANTY IF FLEXIBLE CONNECTORS ARE NOT INSTALLED PER NOTE 4.

SCALE	NTS	LAYOUT DRAWING	
DATE	01-22-15	C42 SERIES - SINGLE - 2900	
DRAWN	GAMatusin		
CHKD	GAM		
APPD.	GAM	DRAWING NO.	C42 2" SINGLE
		SHEET 1 OF 1	REV. 0

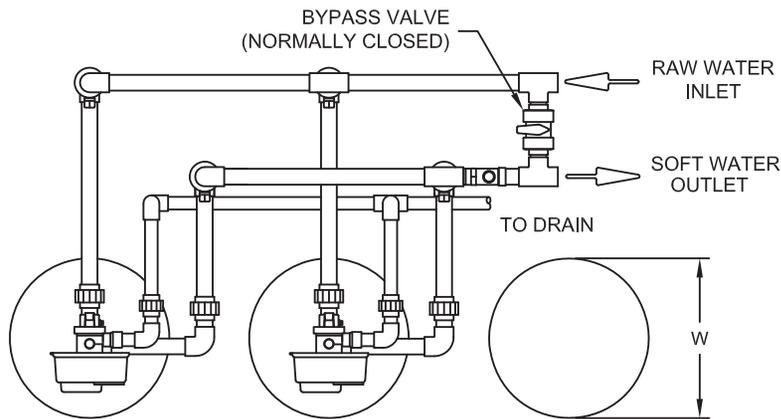


MODEL NO.	L	W	Ds	Hs	Db	Hb
C42-0090-20	55	18	14	77	18	40
C42-0120-20	65	24	16	77	24	41
C42-0150-20	69	24	18	80	24	50
C42-0180-20	75	24	21	74	24	50
C42-0210-20	75	24	21	74	24	50
C42-0240-20	81	24	24	81	24	50
C42-0270-20	81	24	24	87	24	50
C42-0300-20	81	30	24	87	30	50
C42-0450-20	99	30	30	98	30	50
C42-0600-20	120	39	36	95	39	48

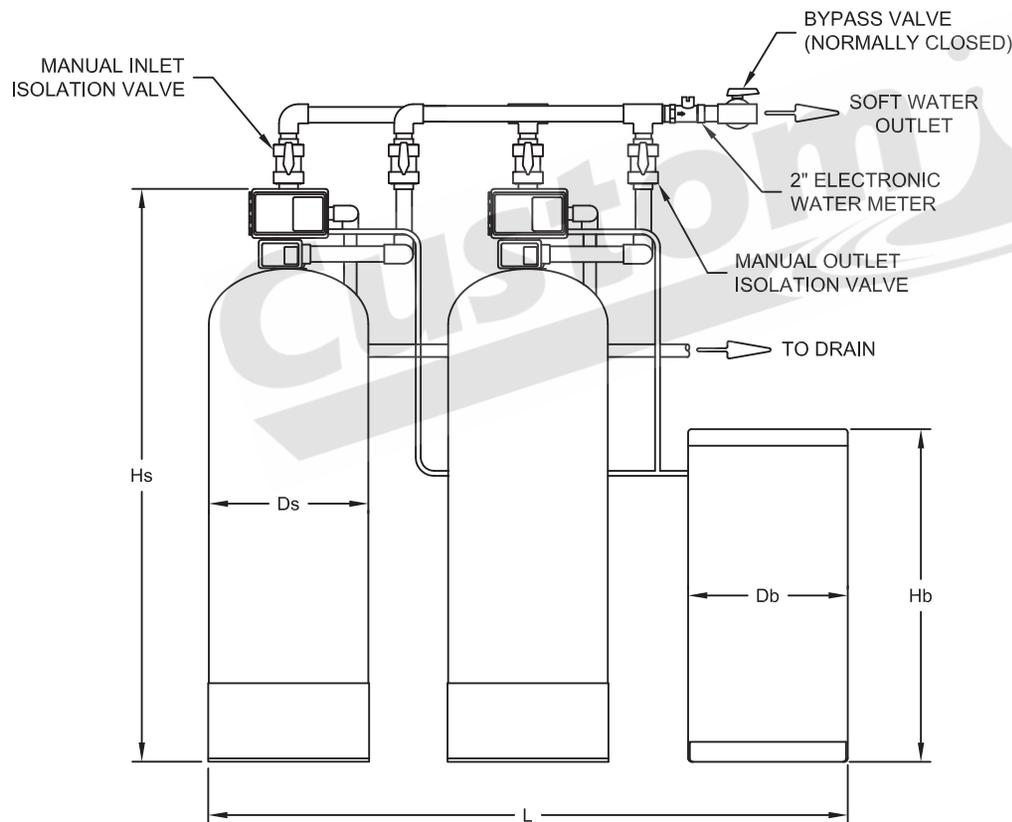


NOTES:

- 1) VALVE INLET AND OUTLET CONNECTIONS ARE 2" NPTF.
- 2) VALVE DRAIN CONNECTION IS 1" NPTM.
- 3) PIPE AND FITTINGS ARE NOT FURNISHED.
- 4) IT IS RECOMMENDED THAT FLEXIBLE CONNECTORS BE INSTALLED BETWEEN HARD PIPING AND VALVE INLET AND OUTLET CONNECTIONS.
- 5) THE TANK MANUFACTURER RESERVES THE RIGHT TO INVALIDATE THE TANK WARRANTY IF FLEXIBLE CONNECTORS ARE NOT INSTALLED PER NOTE 4.

SCALE	NTS	LAYOUT DRAWING	
DATE	03-03-15	C42 SERIES - DUPLEX ALTERNATING - 2900	
DRAWN	GAMatusin		
CHKD	GAM		
APPD.	GAM	DRAWING NO.	C42 2" DUPLEX ALTERNATING
		SHEET	1 OF 1
			REV. 0

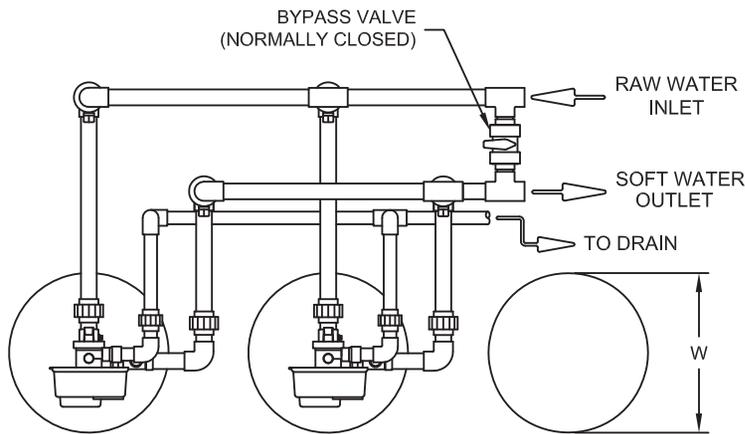



MODEL NO.	L	W	Ds	Hs	Db	Hb
C42-0090-20	55	18	14	77	18	40
C42-0120-20	65	24	16	77	24	41
C42-0150-20	69	24	18	80	24	50
C42-0180-20	75	24	21	74	24	50
C42-0210-20	75	24	21	74	24	50
C42-0240-20	81	24	24	81	24	50
C42-0270-20	81	24	24	87	24	50
C42-0300-20	81	30	24	87	30	50
C42-0450-20	99	30	30	98	30	50
C42-0600-20	120	39	36	95	39	48

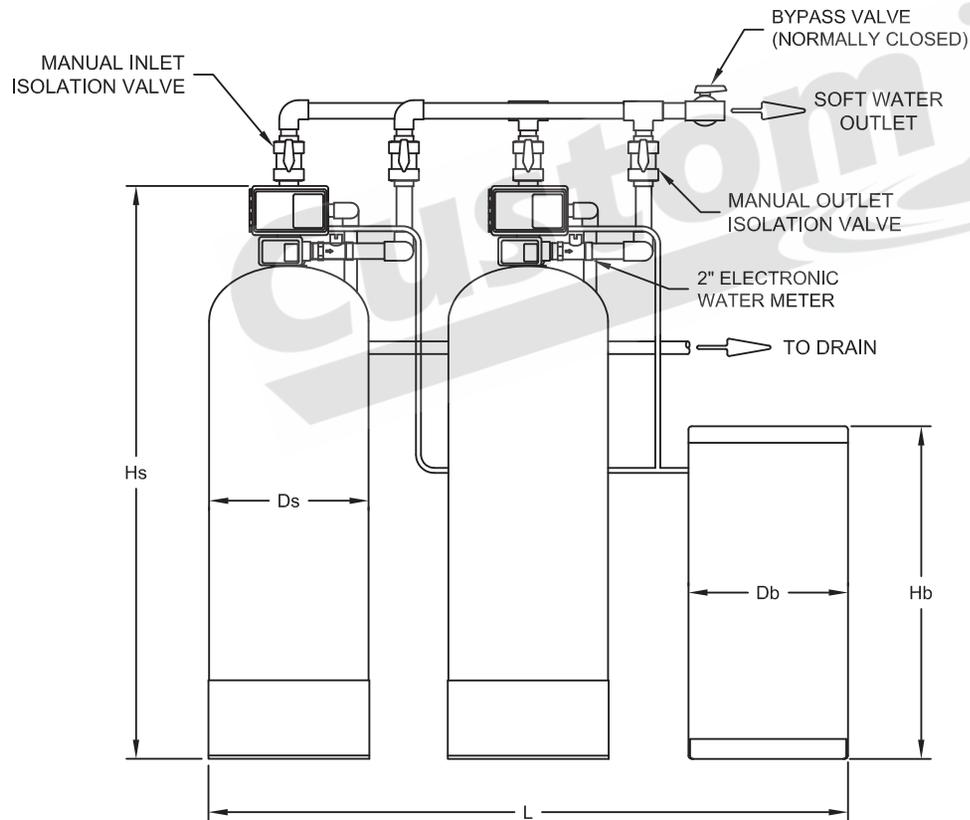

NOTES:

- 1) VALVE INLET AND OUTLET CONNECTIONS ARE 2" NPTF.
- 2) VALVE DRAIN CONNECTION IS 1" NPTM.
- 3) PIPE AND FITTINGS ARE NOT FURNISHED.
- 4) IT IS RECOMMENDED THAT FLEXIBLE CONNECTORS BE INSTALLED BETWEEN HARD PIPING AND VALVE INLET AND OUTLET CONNECTIONS.
- 5) THE TANK MANUFACTURER RESERVES THE RIGHT TO INVALIDATE THE TANK WARRANTY IF FLEXIBLE CONNECTORS ARE NOT INSTALLED PER NOTE 4.

SCALE	NTS	LAYOUT DRAWING	
DATE	03-03-15	C42 SERIES - DUPLEX DEMAND RECALL - 2900	
DRAWN	GAMatusin		
CHKD	GAM		
APPD.	GAM	DRAWING NO.	REV.
		C42 2" DUPLEX DEMAND RECALL	0
		SHEET 1 OF 1	

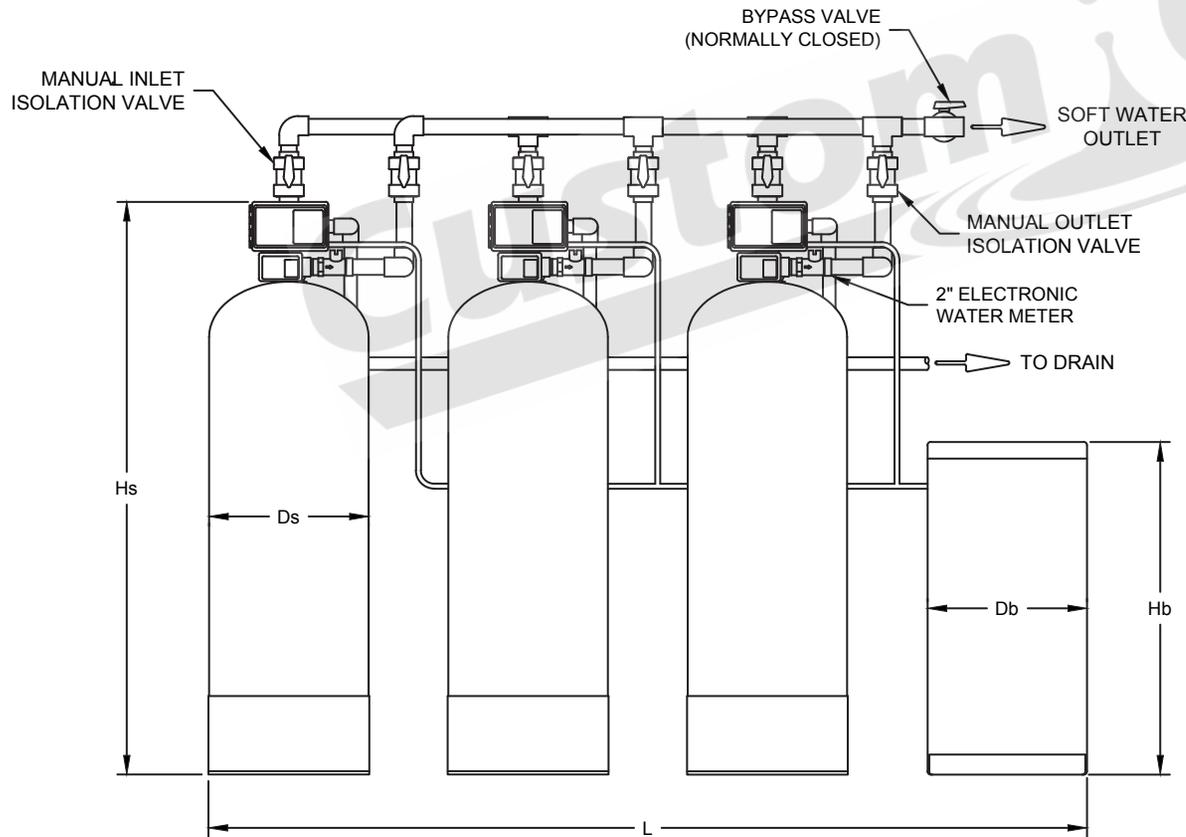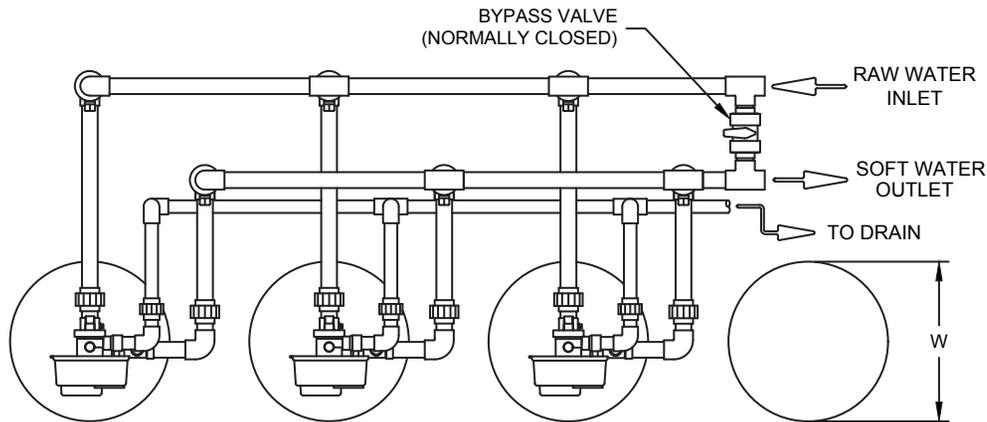

MODEL NO.	L	W	Ds	Hs	Db	Hb
C42-0090-20	72	18	14	77	18	40
C42-0120-20	84	24	16	77	24	41
C42-0150-20	90	24	18	80	24	50
C42-0180-20	99	24	21	74	24	50
C42-0210-20	99	24	21	74	24	50
C42-0240-20	108	24	24	81	24	50
C42-0270-20	108	24	24	87	24	50
C42-0300-20	108	30	24	87	30	50
C42-0450-20	132	30	30	98	30	50
C42-0600-20	159	39	36	95	39	48

NOTES:

- 1) VALVE INLET AND OUTLET CONNECTIONS ARE 2" NPTF.
- 2) VALVE DRAIN CONNECTION IS 1" NPTM.
- 3) PIPE AND FITTINGS ARE NOT FURNISHED.
- 4) IT IS RECOMMENDED THAT FLEXIBLE CONNECTORS BE INSTALLED BETWEEN HARD PIPING AND VALVE INLET AND OUTLET CONNECTIONS.
- 5) THE TANK MANUFACTURER RESERVES THE RIGHT TO INVALIDATE THE TANK WARRANTY IF FLEXIBLE CONNECTORS ARE NOT INSTALLED PER NOTE 4.

SCALE	NTS	LAYOUT DRAWING	
DATE	03-03-15	C42 SERIES - TRIPLE DEMAND RECALL - 2900	
DRAWN	GAMatusin		
CHKD	GAM		
APPD.	GAM	DRAWING NO.	C42 2" TRIPLE DEMAND RECALL
		SHEET	1 OF 1
			REV. 0