
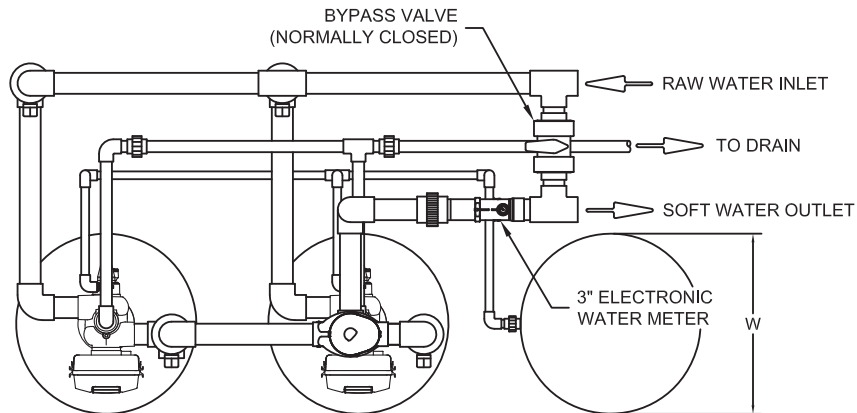


MODEL NO.	L	W	Ds	Hs	Db	Hb
C43-0240-30	54	24	24	87	24	50
C43-0270-30	54	24	24	87	24	50
C43-0300-30	54	30	24	87	30	50
C43-0450-30	66	30	30	99	30	50
C43-0600-30	81	39	36	96	39	48
C43-0750-30	87	42	42	107	39	60
C43-0900-30	90	42	42	107	42	60
C43-1050-30	104	50	48	105	50	60
C43-1200-30	104	50	48	105	50	60


NOTES:

- 1) VALVE INLET AND OUTLET CONNECTIONS ARE 3" NPTF.
- 2) VALVE DRAIN CONNECTION IS 3" NPTF.
- 3) PIPE AND FITTINGS ARE NOT FURNISHED.
- 4) IT IS RECOMMENDED THAT FLEXIBLE CONNECTORS BE INSTALLED BETWEEN HARD PIPING AND VALVE INLET AND OUTLET CONNECTIONS.
- 5) THE TANK MANUFACTURER RESERVES THE RIGHT TO INVALIDATE THE TANK WARRANTY IF FLEXIBLE CONNECTORS ARE NOT INSTALLED PER NOTE 4.

SCALE	NTS	LAYOUT DRAWING C43 3" SERIES - SINGLE	
DATE	05-20-15		
DRAWN	GAMatusin		
CHK'D	GAM		
APP'D.	GAM	DRAWING NO.	REV.
		C43 3" SINGLE	0
		SHEET 1 OF 1	




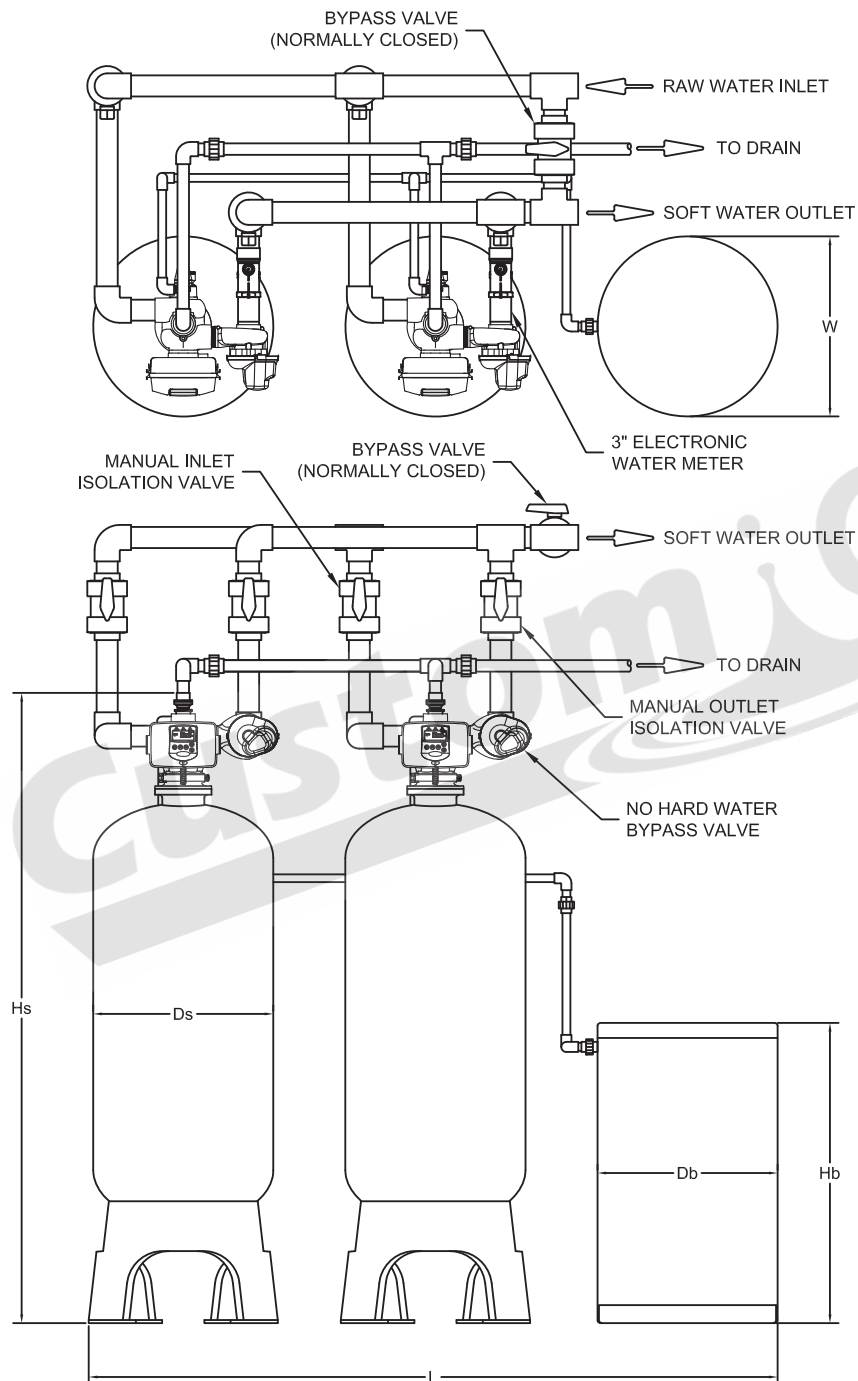
MODEL NO.	L	W	Ds	Hs	Db	Hb
C43-0240-30	81	24	24	87	24	50
C43-0270-30	81	24	24	87	24	50
C43-0300-30	81	30	24	87	30	50
C43-0450-30	99	30	30	99	30	50
C43-0600-30	120	39	36	96	39	48
C43-0750-30	132	42	42	107	39	60
C43-0900-30	135	42	42	107	42	60
C43-1050-30	155	50	48	105	50	60
C43-1200-30	155	50	48	105	50	60

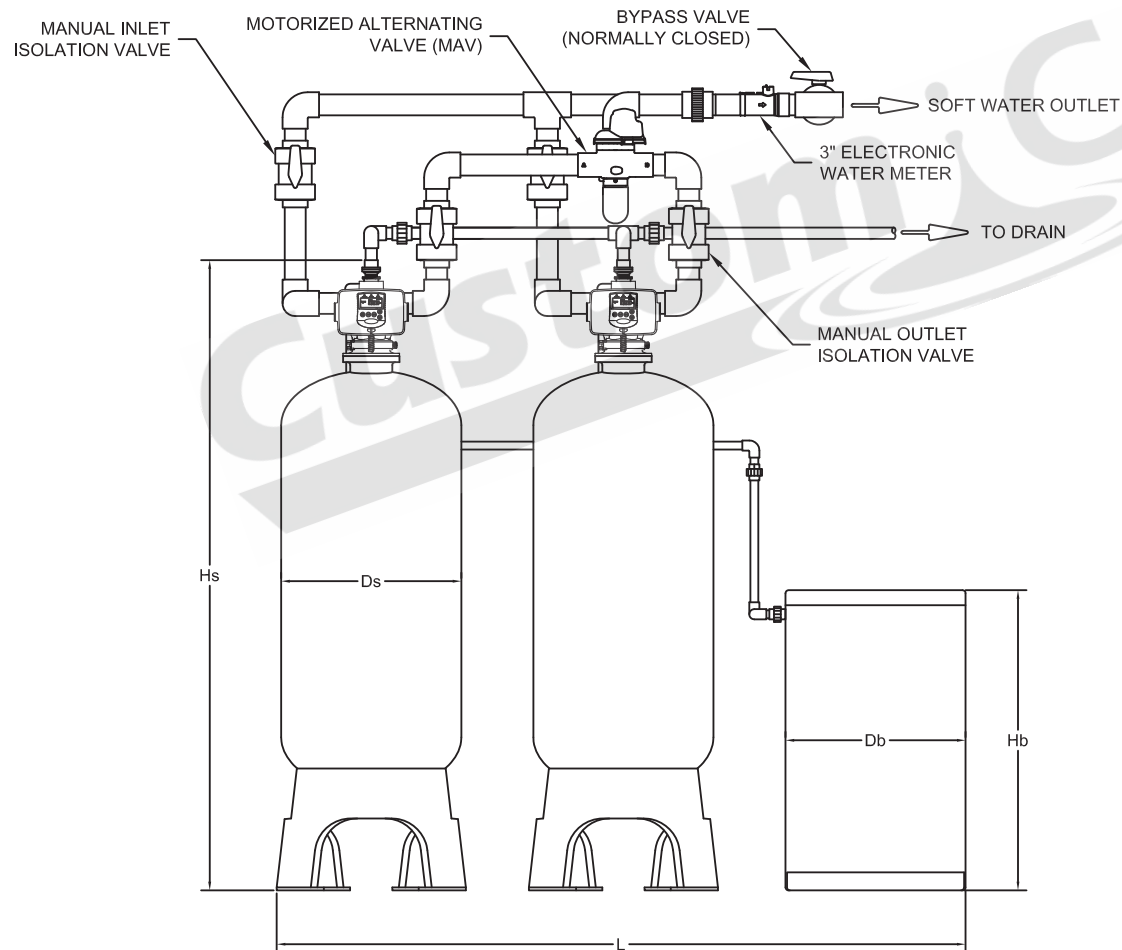

NOTES:

- 1) VALVE INLET AND OUTLET CONNECTIONS ARE 3" NPTF.
- 2) VALVE DRAIN CONNECTION IS 3" NPTF.
- 3) PIPE AND FITTINGS ARE NOT FURNISHED.
- 4) IT IS RECOMMENDED THAT FLEXIBLE CONNECTORS BE INSTALLED BETWEEN HARD PIPING AND VALVE INLET AND OUTLET CONNECTIONS.
- 5) THE TANK MANUFACTURER RESERVES THE RIGHT TO INVALIDATE THE TANK WARRANTY IF FLEXIBLE CONNECTORS ARE NOT INSTALLED PER NOTE 4.


SCALE	NTS	LAYOUT DRAWING	
DATE	05-20-15	C43 3" SERIES - DUPLEX ALTERNATING	
DRAWN	GAMatusin		
CHKD	GAM		
APPD.	GAM	DRAWING NO.	REV.
		C43 3" DUPLEX ALTERNATING	0
		SHEET 1 OF 1	




MODEL NO.	L	W	Ds	Hs	Db	Hb
C43-0240-30	81	24	24	87	24	50
C43-0270-30	81	24	24	87	24	50
C43-0300-30	81	30	24	87	30	50
C43-0450-30	99	30	30	99	30	50
C43-0600-30	120	39	36	96	39	48
C43-0750-30	132	42	42	107	39	60
C43-0900-30	135	42	42	107	42	60
C43-1050-30	155	50	48	105	50	60
C43-1200-30	155	50	48	105	50	60


NOTES:

- 1) VALVE INLET AND OUTLET CONNECTIONS ARE 3" NPTF.
- 2) VALVE DRAIN CONNECTION IS 3" NPTF.
- 3) PIPE AND FITTINGS ARE NOT FURNISHED.
- 4) IT IS RECOMMENDED THAT FLEXIBLE CONNECTORS BE INSTALLED BETWEEN HARD PIPING AND VALVE INLET AND OUTLET CONNECTIONS.
- 5) THE TANK MANUFACTURER RESERVES THE RIGHT TO INVALIDATE THE TANK WARRANTY IF FLEXIBLE CONNECTORS ARE NOT INSTALLED PER NOTE 4.

SCALE	NTS	LAYOUT DRAWING	
DATE	05-20-15	C43 3" SERIES - DUPLEX DEMAND RECALL	
DRAWN	GAMatusin		
CHKD	GAM		
APP'D.	GAM	DRAWING NO.	REV.
		C43 3" DUPLEX DEMAND RECALL	0
		SHEET 1 OF 1	

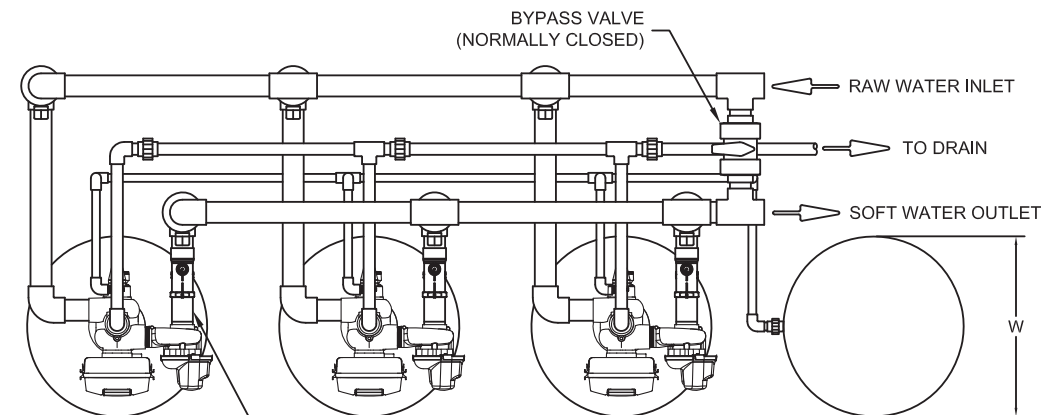

MODEL NO.	L	W	Ds	Hs	Db	Hb
C43-0240-30	108	24	24	87	24	50
C43-0270-30	108	24	24	87	24	50
C43-0300-30	108	30	24	87	30	50
C43-0450-30	132	30	30	99	30	50
C43-0600-30	159	39	36	96	39	48
C43-0750-30	177	42	42	107	39	60
C43-0900-30	180	42	42	107	42	60
C43-1050-30	206	50	48	105	50	60
C43-1200-30	206	50	48	105	50	60

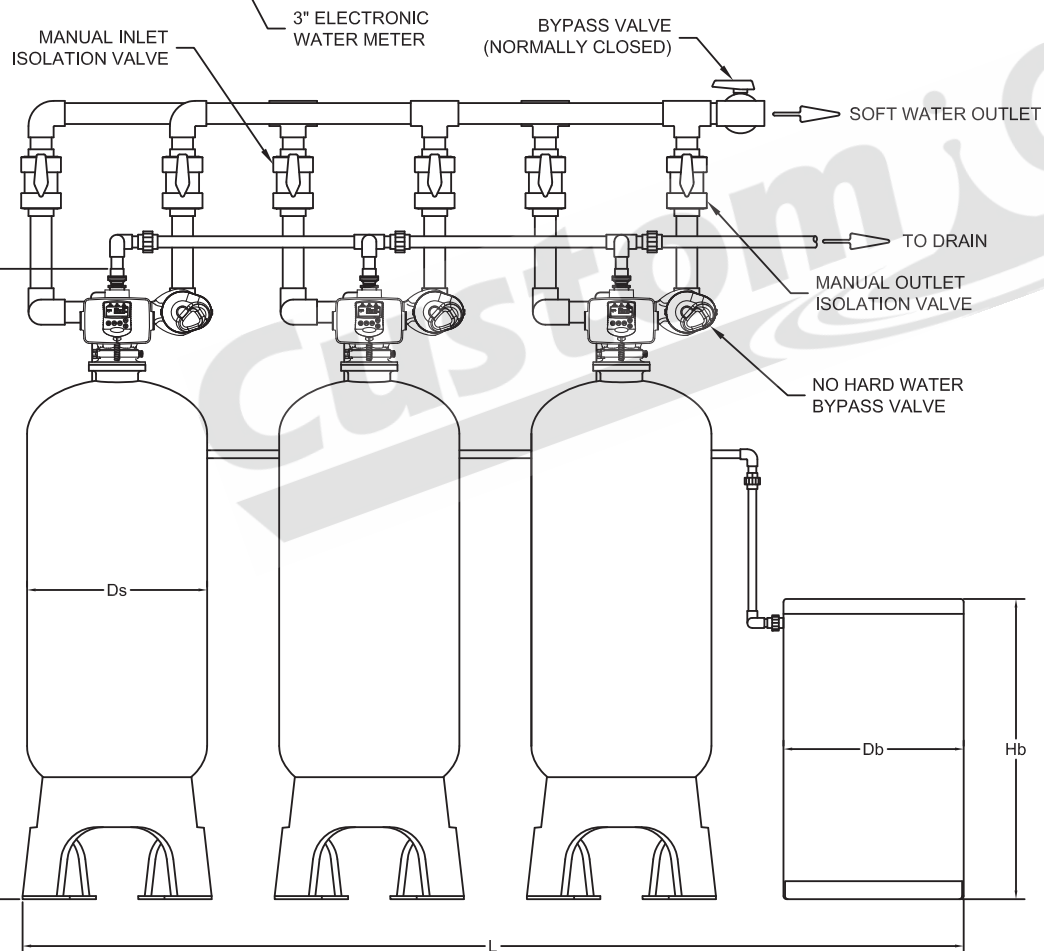

NOTES:

- 1) VALVE INLET AND OUTLET CONNECTIONS ARE 3" NPTF.
- 2) VALVE DRAIN CONNECTION IS 3" NPTF.
- 3) PIPE AND FITTINGS ARE NOT FURNISHED.
- 4) IT IS RECOMMENDED THAT FLEXIBLE CONNECTORS BE INSTALLED BETWEEN HARD PIPING AND VALVE INLET AND OUTLET CONNECTIONS.
- 5) THE TANK MANUFACTURER RESERVES THE RIGHT TO INVALIDATE THE TANK WARRANTY IF FLEXIBLE CONNECTORS ARE NOT INSTALLED PER NOTE 4.

SCALE	NTS	LAYOUT DRAWING
DATE	05-20-15	C43 3" SERIES - TRIPLE DEMAND RECALL
DRAWN	GAMatusin	
CHKD	GAM	
APPD.	GAM	DRAWING NO. C43 3" TRIPLE DEMAND RECALL SHEET 1 OF 1
		REV. 